



SERVICE TRENCH

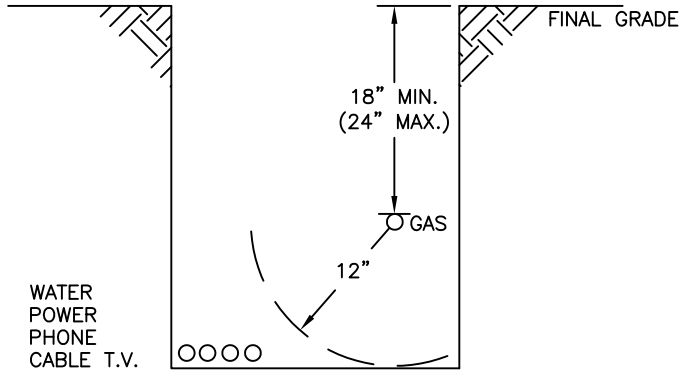

12" MINIMUM SEPARATION FROM ALL OTHER UTILITIES.

**CONTACT ALL OTHER UTILITIES FOR
THEIR JOINT TRENCH SPECIFICATIONS.**

MAIN TRENCH

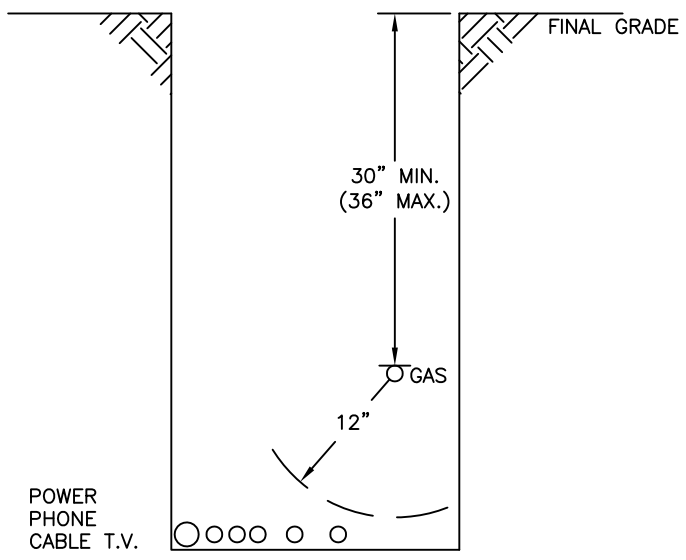

12" MINIMUM SEPARATION FROM ALL OTHER UTILITIES.

**WET UTILITIES:
36" SEPARATION FROM MAIN,
12" SEPARATION FROM SERVICE.**

**CONTACT ALL OTHER UTILITIES FOR
THEIR JOINT TRENCH SPECIFICATIONS.**

3	CSC	KFS	REVISED SEPARATION WORDING	1/21/08					
2	CSC	KFS	REVISED SEPARATION WORDING	6/27/06	4	B3H	L2C	ADDED MAX DEPTH TO MAIN TRENCH	7/26/18
REV	DR.	APP.	REVISION	DATE	REV	DR.	APP.	REVISION	DATE

BAR IS ONE INCH ON ORIGINAL DRAWING.

ADJUST SCALE AS SHOWN ACCORDINGLY.

STANDARD DRAWING TRENCH SPECIFICATIONS



DR. CSC	SCALE 3/4" = 1' 0"
APP. DATE 8/25/05	APP. BY L2C - INITIAL REL.
DWG. NO. W-00-11-A	